Technical Bulletin

AMBIRAD
HEATING AND VENTILATION SOLUTIONS

NRV LR UPDATE

Warnings

All external wiring MUST comply with the current IEE wiring regulations.
These instruction MUST be used in conjunction with the appropriate controller and heater manual.

Visit our Support Database
at www.s-i-d.co.uk

Part No. 706107

Nortek Global HVAC (UK) Limited, Fens Pool Avenue, Brierley Hill, West Midlands, DY5 1QA

General Information.

We have recently released some minor revisions to the NRV Nor-Ray-Vac LR burner range. These include:

Gas injector changed from 3.6mm to 3.5mm (new part no. L100535) on 12LRG20
Gas injector changed from 2.9mm to 2.8mm (new part no. L100528) on 12LRG31
Gas injector changed from 4.4mm to 4.3mm (new part no. L100543) on 18LRG20

Air pressure switch changed from part no. L104039 (orange identification label) to part no. 202861 (grey identification label).

Instruction manual Art 700050, document reference GB/NRV/193 updated to indicate above changes and generation code (AA) indicated on front cover.

Data label updated to include the generation code (AA) and new PIN no. 86CP52.

fig.1. Original pressure switch part no. L104039

fig.2. Replacement pressure switch part no. 202861

fig.3 Wiring and tube connnection details.

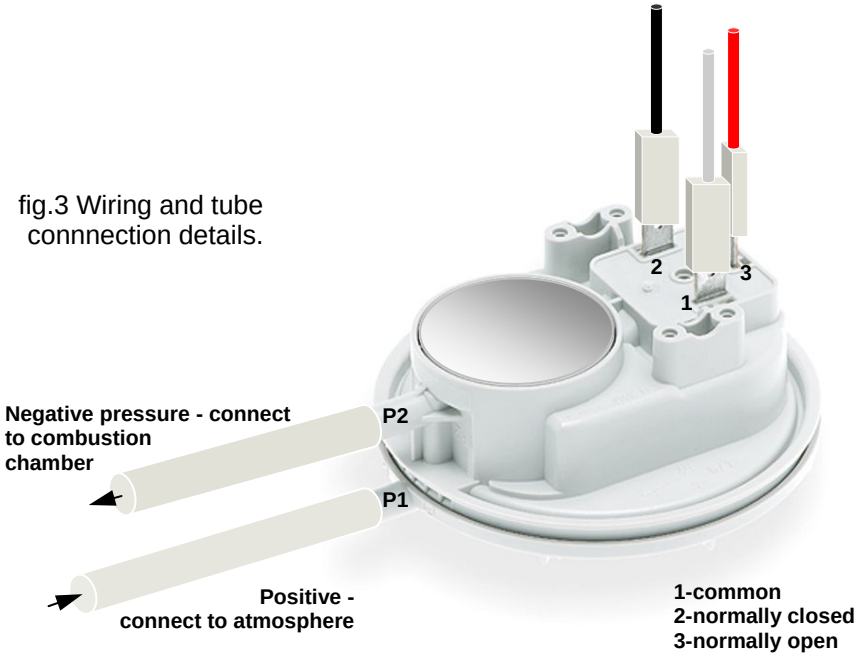

Nortek Global HVAC (UK) Ltd
Fens Pool Avenue
Brierley Hill
West Midlands DY5 1QA
United Kingdom

Tel: **01384 489250**
Fax: **01384 489707**

ambiradsales@nortek.com
www.ambirad.co.uk

Document reference number **TB/107/0516**

NORTEK™ GLOBAL HVAC

AMBIRAD AIRBLOC NORDAIRNICHE BENSON

Registered in England No. 1390934. Registered office: 10 Norwich Street, London, EC4A 1BD

Nortek Global HVAC is a registered trademark of Nortek Global HVAC Limited. Because of continuous product innovation, Nortek Global HVAC reserves the right to change product specification without due notice.